



FRONT OFFICE - HVAC CONTROL SYSTEM

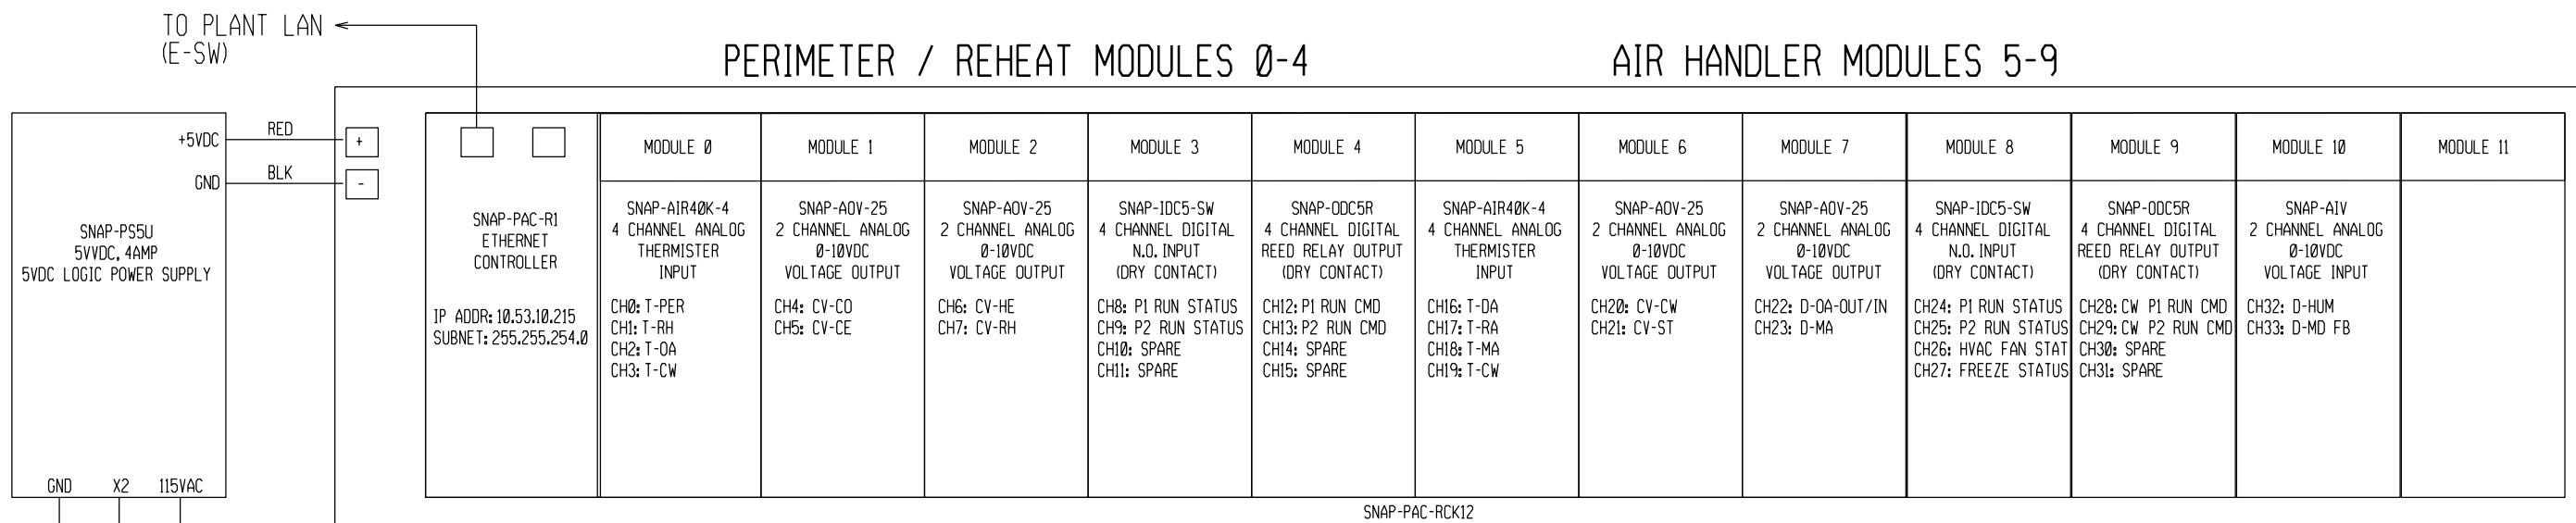

- NOTES:
- SEND DATA TO PI FOR DATA COLLECTING AND TRENDING.
 - LOCAL CONTROL USING PC/HMI.
 - REMOTE CONTROL FROM USER PC.

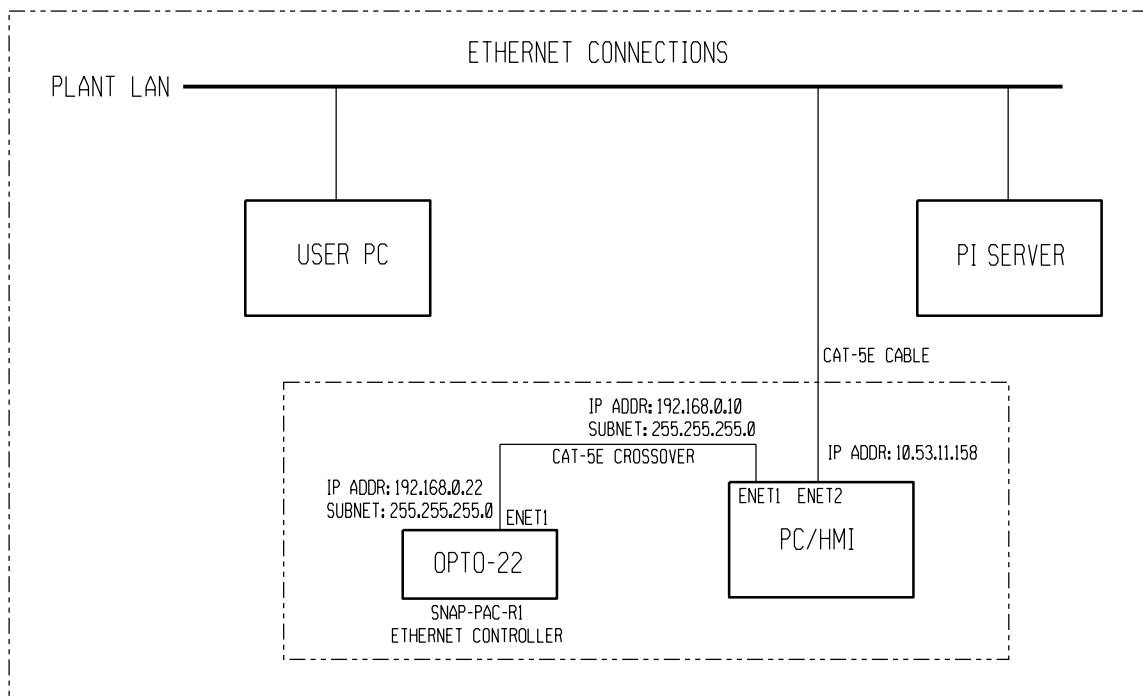

T-DA: DELIVERED AIR TEMPERATURE
 T-RA: RETURN AIR TEMPERATURE
 T-OA: OUTSIDE TEMPERATURE
 T-MA: MIXED AIR TEMPERATURE
 T-RH: REHEAT WATER TEMPERATURE
 T-PER: PERIMETER WATER TEMPERATURE
 T-CW: CHILLER WATER TEMP (NEW)
 D-HUM: DUCT HUMIDITY SENSOR

CV-CO: H/C CHANGE-OVER
 CV-CE: COOLING EXCHANGER
 CV-HE: HEAT EXCHANGER
 CV-ST: STEAM CONTROL VALVE
 CV-CW: CHILLED WATER CONTROL VALVE
 CV-RH: REHEAT EXCHANGER

DATE PLOTTED \$\$\$DATE\$\$\$

SUBJECT INDEX		REFERENCE DRAWINGS	
DWG. NO.	TITLE	DWG. NO.	TITLE
008 468100	- MASTER DRAWING LIST	-	-

008 - 00 - E - 76 - 5400

DO NOT SCALE THIS PRINT	DATE	SCALE	THIS PRINT
REV. BY			
DATE			
REV. BY			
DATE			
REV. BY			
DATE			
REV. BY			
DATE			

DRAWN BY JFA DATE 7-11-16

CHECKED DATE

APPROVED DATE

SCALE NONE

FRAME NO.

DRAWING NO. 008 HVAC4